
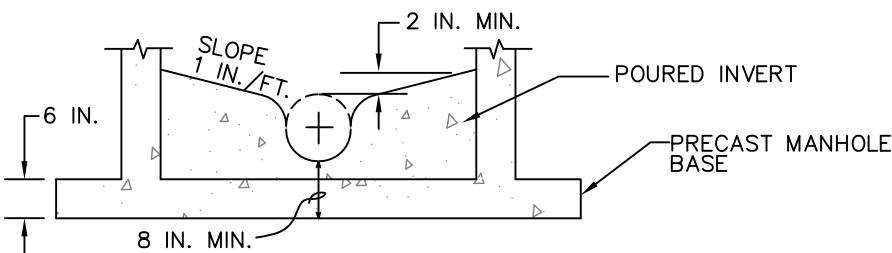


24 IN. RING AND COVER - 400 LB.
DENVER HEAVY BY MACLEAR
OR APPROVED EQUAL

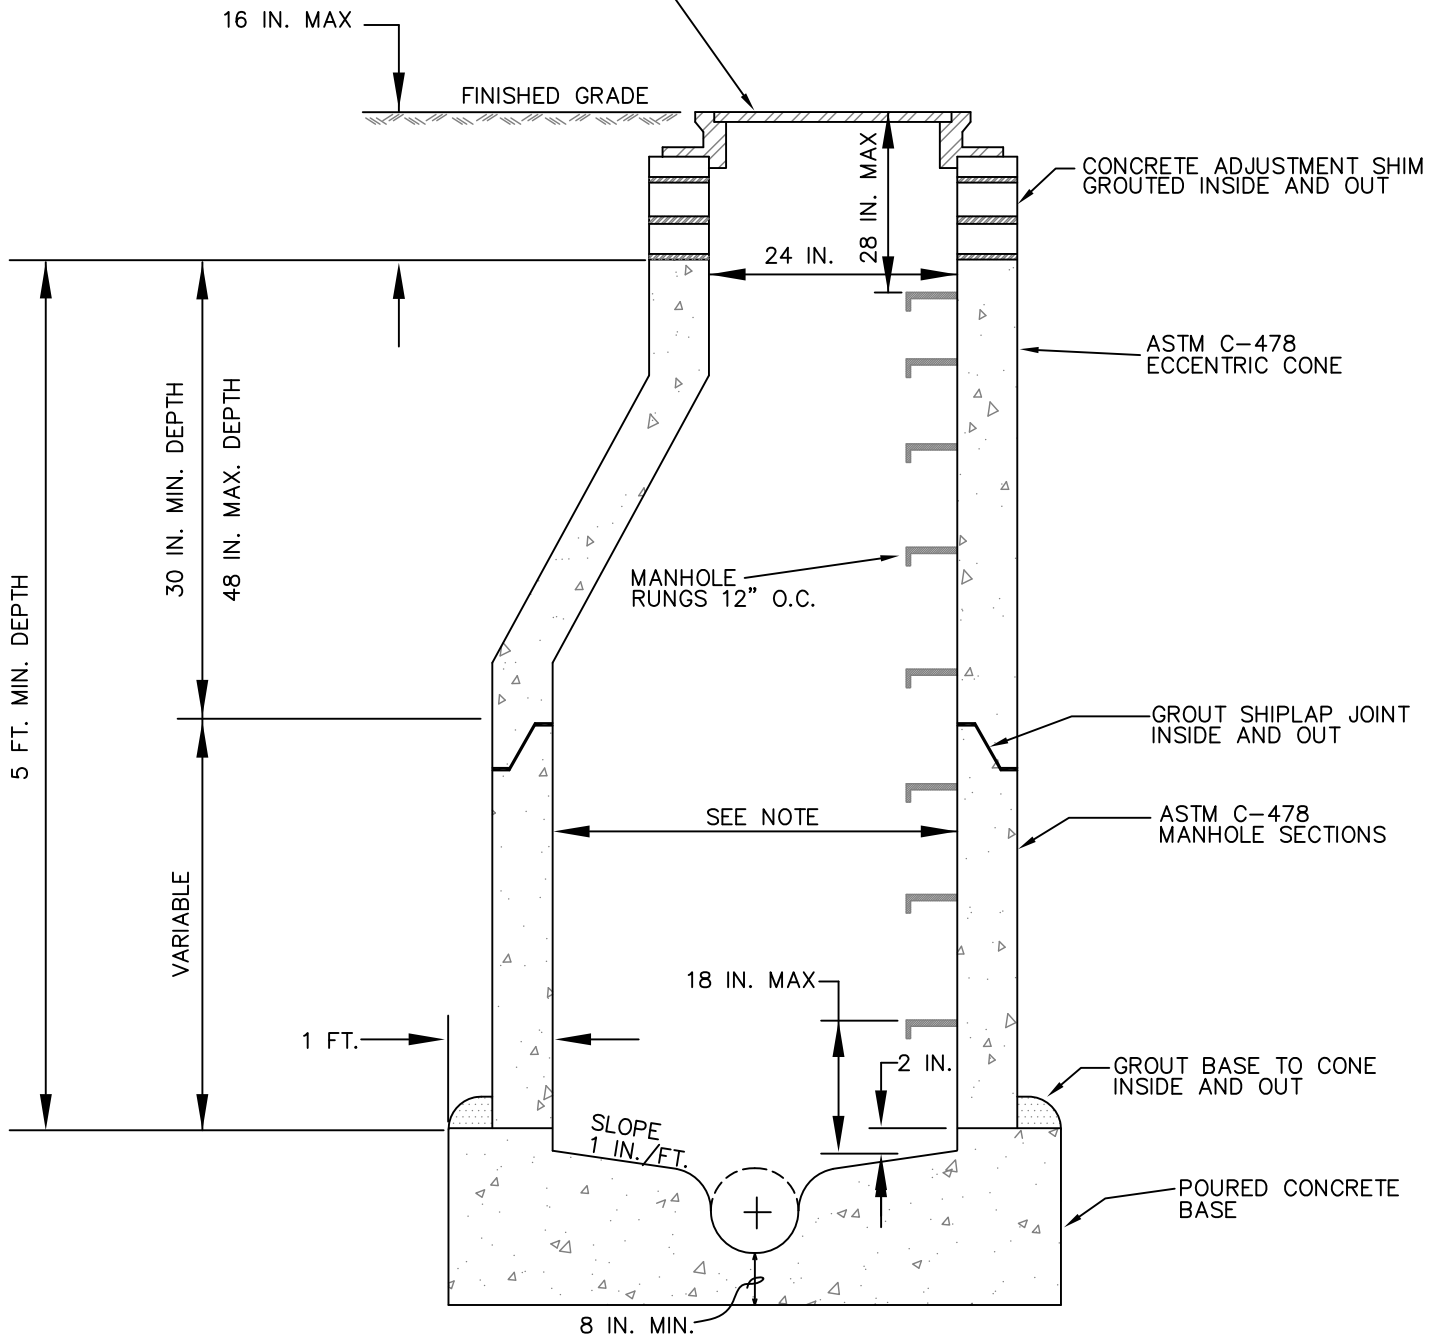

ALTERNATE BASE

NOTE: MINIMUM INSIDE DIAMETER OF
MANHOLE SHALL BE AS FOLLOWS:

PIPE SIZE	MIN. MANHOLE DIAMETER
24 IN. OR LESS	48 IN.
27 IN. TO 42 IN. (INCL.)	60 IN.
OVER 42 IN.	72 IN.

REV. DATE: 12/11/13

STANDARD MANHOLE



CITY OF
FORT COLLINS
UTILITIES
FORT COLLINS, CO.
(970) 221-6700

STORMWATER
CONSTRUCTION DETAILS

APPROVED:

DATE: 11/7/00

DRAWN BY: NBJ

DETAIL

D-3