



ADDENDUM No. 5

SPECIFICATIONS AND CONTRACT DOCUMENTS

Description of Bid #5952 Spring Canyon Community Park

OPENING DATE: February 3, 2006, 3:00P.M. (Our Clock)

To all prospective bidders under the specifications and contract documents described above, the following changes are hereby made.

Bid Opening Date has been changed to February 3, 2006 3:00 P.M. (our Clock)

CORRECTIONS

1. In addendum 3 under the sub heading Drawings, references to sheet L3 are incorrect. The corrections should be noted on sheet L5
2. In addendum 3 under sub heading Drawings Sheet L6 Bottom Left: 9 - WH should read 7 – WH

ANSWERS TO BIDDER QUESTIONS

1. The fence behind the dugout shall be 5'-6' high; Refer to sheet 22 and details 2 and 4 sheet D25
2. The card reader hardware on sheet S5 shall be provided and installed by owner. Conduit shall be provided per sheet E6
3. There are three 4' access gates and one 12' access gate at the tennis courts; See sheet D27
4. Plant symbol graphics take precedence over plant list and plant drawing labels
5. There is no bid item for general conditions and mobilization. General conditions and mobilization shall be distributed through out the bid items
6. Sandstone boulders may be snapped or cut as long as they meet the joint tolerances called out in details 1,2 and 3 on sheet D13
7. Wood mulch shall be placed in perennial and ornamental grass planting beds, Tree and shrub planting rings. Within the shrub beds in the native seed areas, wood mulch shall be placed in a circle at least 6" beyond the fabric mulch square.
8. Items in the unit price section of the bid form are to be utilized for additions and deletions to the contract. Not all elements in the contract documents are called out in the unit price list.
9. See detail 12 sheet D19 for the crusher fines detail.
10. The Underdrain shall be perforated (ADS N-12 or approved equal) dual wall plastic pipe
11. Storm drainage pipes shall conform to the bid documents.
12. The length of the 6x4 box culvert shall be 24 feet.
13. Details for the 18" PVC irrigation line can be found on sheet C4.1
14. See drawings C1.12 and C1.13 for the location and extent of concrete encasement for the 18" PVC irrigation line.
15. The sanitary sewer crosses Spring Creek north of the creek pavilion. See detail 2 sheet C4.2 for the crossing detail
16. See addendum #3 for head wall details for storm line G.

SPECIFICATIONS

In table of contents; Division 2 section 02380 Rock Setting should be section 02735 Site Rock Work

DRAWINGS

Sheet L10

1. Top Left: 4 - WH should read 6 – PC
2. Bottom Middle: 4 – PA should read 3 – PA

Sheet D13 Detail 1

Add Note: Exposed joints between boulders shall not exceed 1-1/2” in width. Joints between boulder and abutting pavement shall exceed 1-1/2”.

Sheet L21 Detail 2

Remove note “Hand tooled edge”.

Sheet C1.3

Under drain detail call outs shall read C4.14 not C4.13. (Under drain details are found on sheet C4.14

Sheet IR17 Detail 11


Use Rain Bird PESB-XCZ-100-COM drip valve assembly. No PRS-D required for the drip valves as the drip valve assembly comes complete with a pressure regulator

ATTACHMENTS

Drawing D23-A5: Base Ball Fence Layout
Drawing S10-A5: Dog Park Clarifications

RECEIPT OF THIS ADDENDUM MUST BE ACKNOWLEDGED BY A WRITTEN STATEMENT ENCLOSED WITH THE BID/QUOTE STATING THAT THIS ADDENDUM HAS BEEN RECEIVED.

EAST I

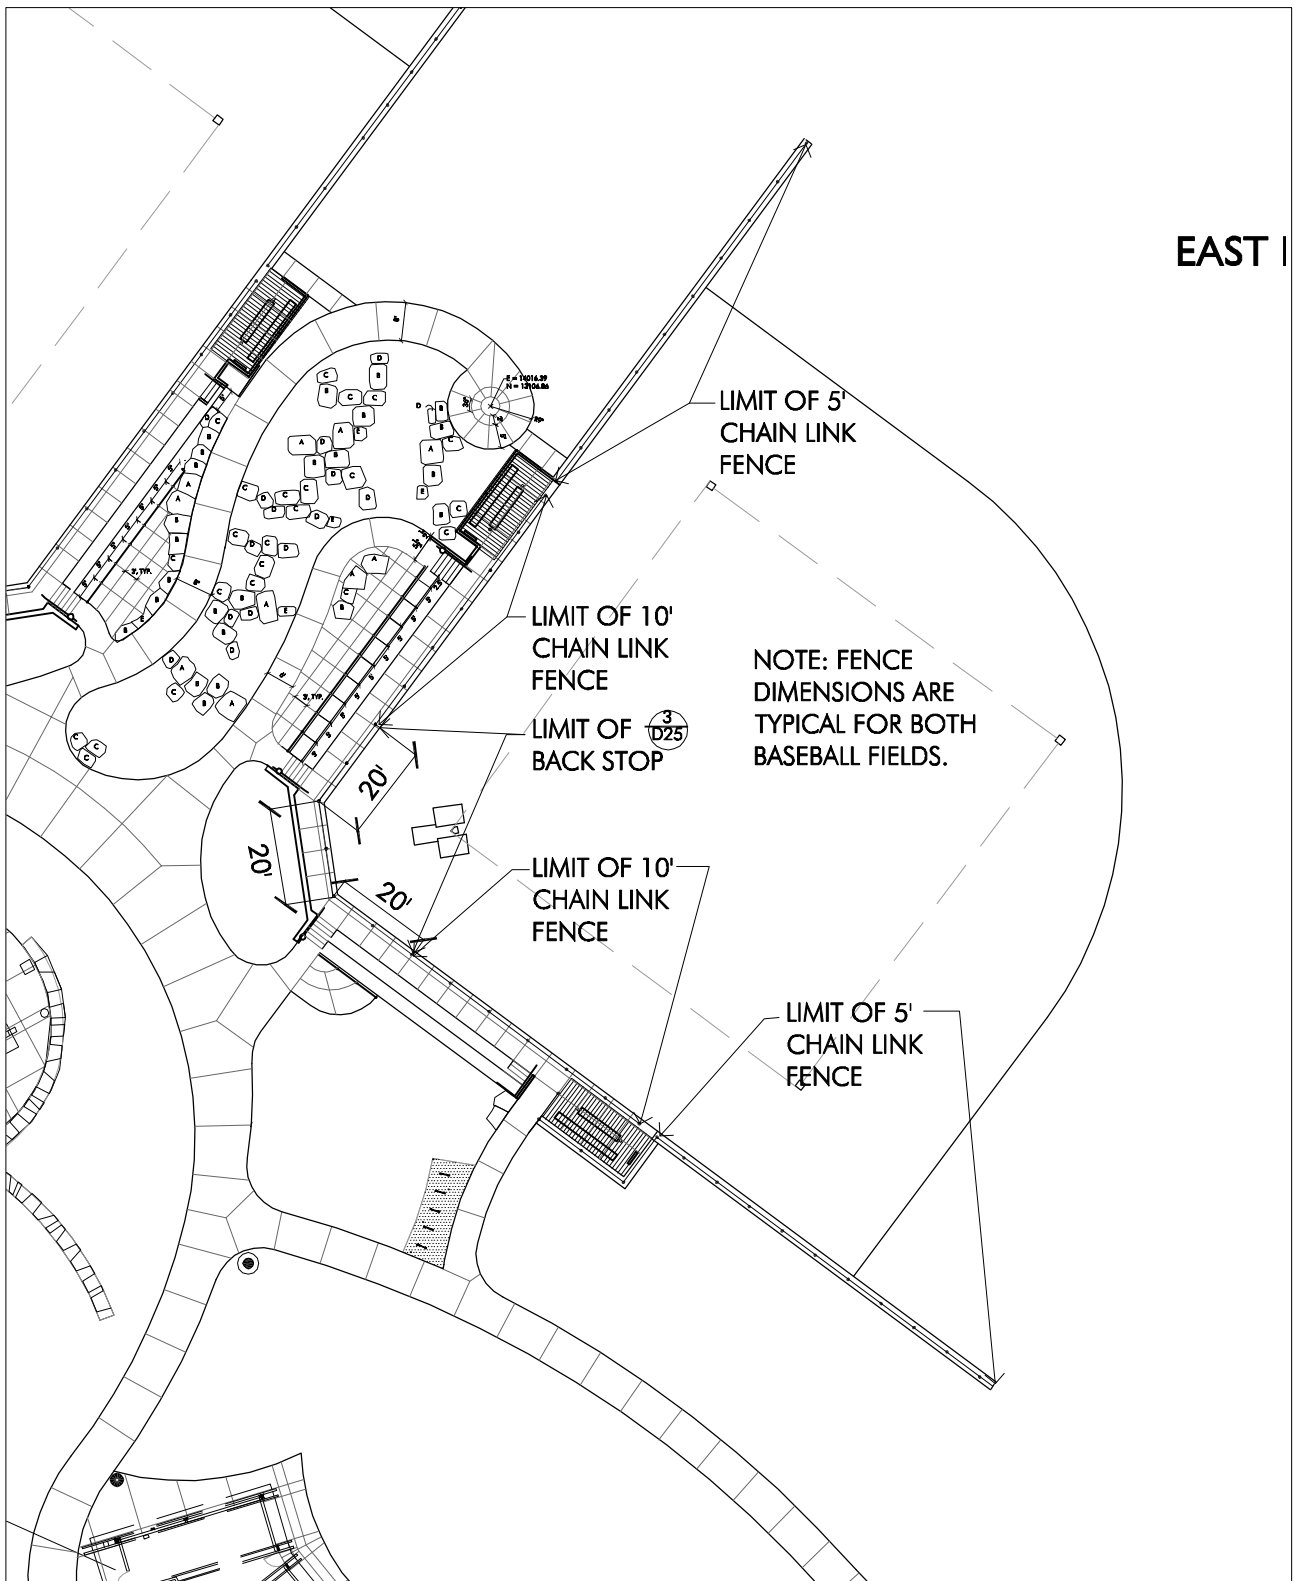

BHA DESIGN, INC.
 4803 Innovation Dr.
 Fort Collins, CO 80525
 phn (970)223-7577
 fax (970)223-1827

PROJECT: Spring Canyon Community Park
 City of Fort Collins

PROJECT NO. 4025 **DATE:** 1-26-06

DESCRIPTION: Addenda #5 (BASEBALL FENCING)

SCALE: 1"=40'

DRAWING NUMBER:
 D23-A5



ISSUE RECORD
 1-26-06

REVISIONS